

SECTION C  
BOLLARD DETAIL  
SCALE: 3/16" = 1'-0"

**DOUBLE WALL TANK SPECIFICATION: (CONTRACTOR PROVIDED)**


- TANK TO BE ALL STEEL CONSTRUCTION, CYLINDER IN DESIGN AND NEW FROM MANUFACTURER. DOUBLE WALL HORIZONTAL ABOVE GROUND FUEL TANK WITH FULL LENGTH SKIDS, REQUIRED THREADED OPENINGS, LIFTING LUGS. FIREGUARD BRAND OR EQUAL.
- TANK SHALL MEET UL 2085 OR 142 SPECIFICATION.
- TANK MUST HAVE A TOTAL OF (6) 4-INCH THREADED INLETS WITH FOUR (4) CAPPED FOR FUTURE USE.
- TANK WILL BE FITTED WITH TWO (2) 6" MORRISON TYPE EMERGENCY VENTS, ONE PRIMARY AND ONE INTERSTITIAL, RATED AT 8/OZ/SQUARE INCH, ONE (1) TWO-INCH ATMOSPHERIC UPDRAFT VENT (3542) FOR DIESEL.
- TANK SHALL BE EQUIPPED WITH A 2-INCH OVERFILL PREVENTION VALVE WITH A MINIMUM ULLAGE OF 3-4" AND A MINIMUM FIVE (5) GALLON SPILL CONTAINMENT BASIN EQUIPPED WITH A PUSH-TO-OPEN DRAIN VALVE.
- TANK TO BE PRIMED AND PAINTED WITH WHITE ENAMEL EXTERIOR PAINT.
- TANK SHALL BE INSTALLED FOR A COMPLETE AND FUNCTIONAL DEVICE.

**MECHANICAL FUEL PUMP SPECIFICATION: (CONTRACTOR PROVIDED)**


DRESSER WAYNE, RELIANCE MODEL NUMBER G6202P, TWIN 1, 2-HOSE, 1-PRODUCT, 1-PUMP, (1) 1 HP WITH 1" SOLENOID VALVE. PULSERS, 100:1 RATIO AND LIGHTED CABINET WITH TWO (2) HOSES, 3/4" X 12-FOOT CURB PUMP HOSES. TWO (2) NEW OPW 11A NOZZLES WITH REUSABLE HOSE BREAKS OR EQUAL.

LITHONIA HIGH PERFORMANCE FLOODLIGHTING OR EQUAL:  
LIGHT FIXTURES - (2) 55 400M RPN TB TS PER PE1 LP1.  
INCLUDES: BRACKET - SBA28.  
POLE - SSA 16 4G.

HAZARDOUS FLOOD LIGHTING.  
METAL HALIDE ON SQUARE  
POLE ALUMINUM BRACKET.

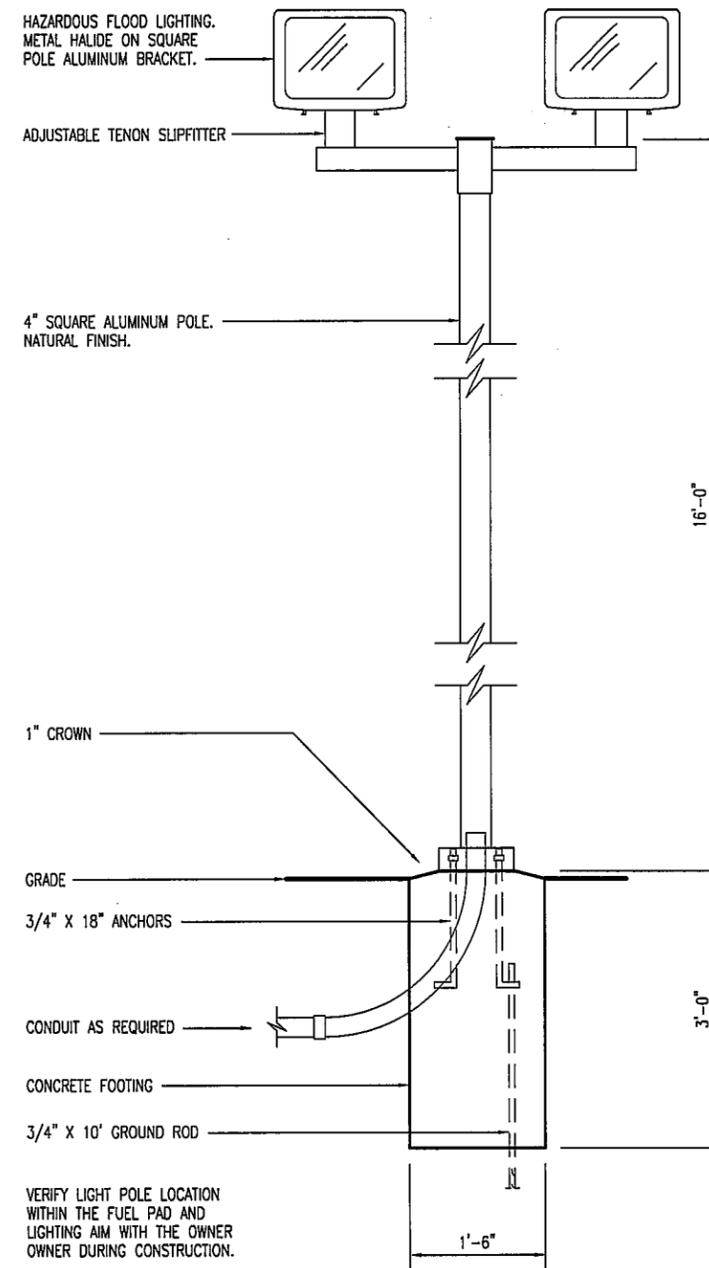

SECTION B  
LIGHT POLE  
SCALE: 1/2" = 1'-0"

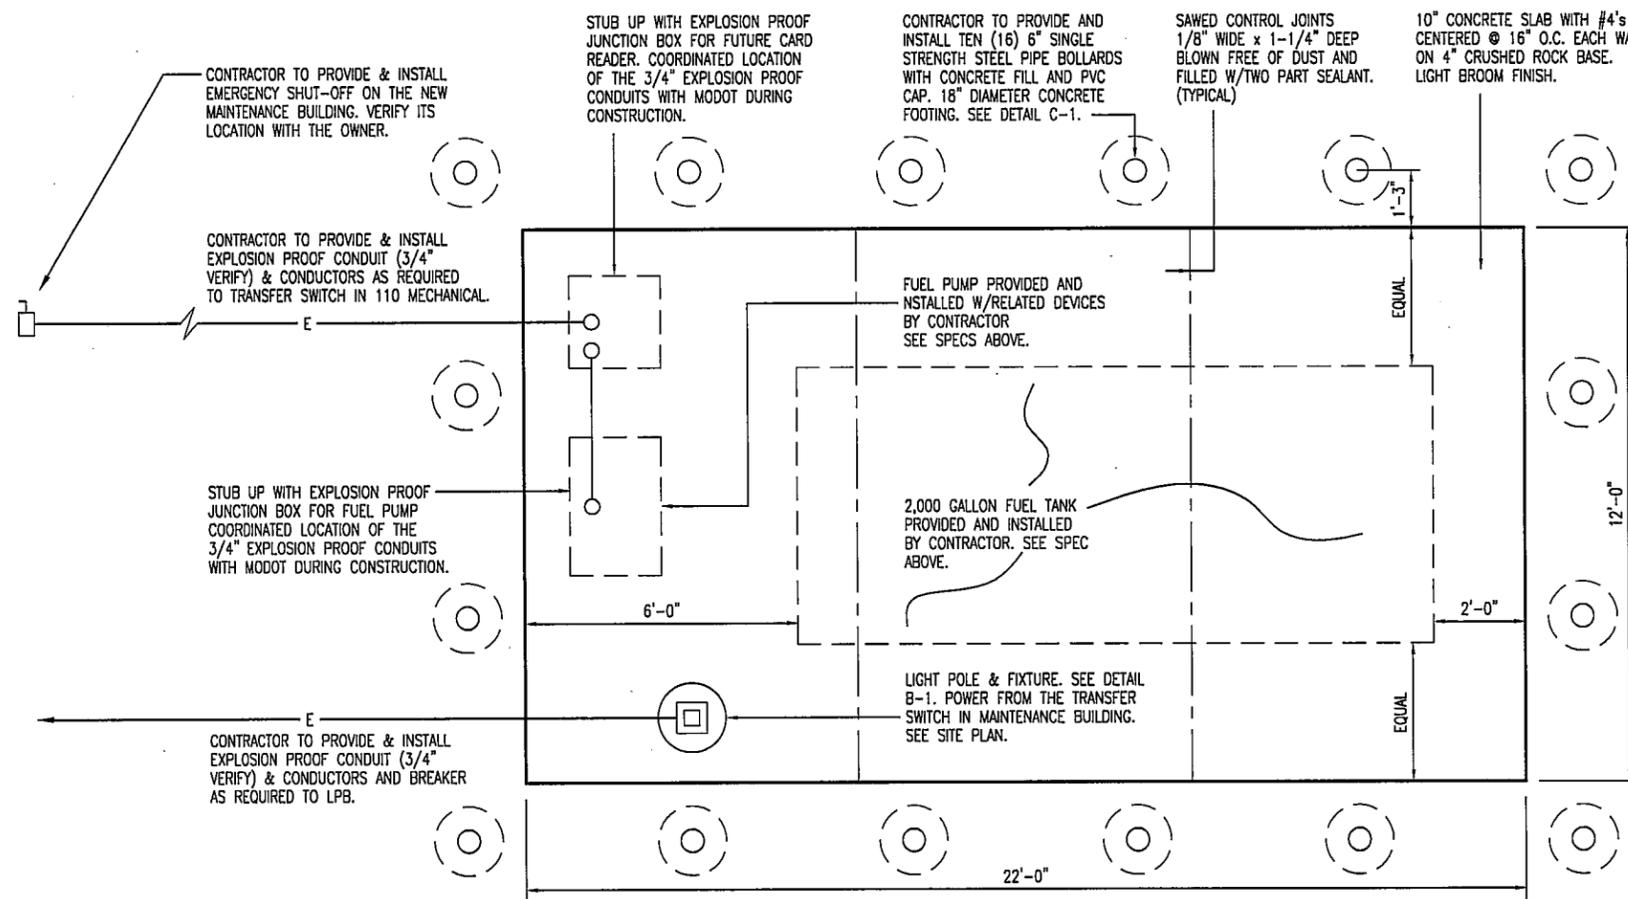

SECTION A  
FUEL PAD  
SCALE: 1/4" = 1'-0"




DESIGN BY: LARRY CARVER  
DRAWN BY: LARRY CARVER  
DATE: 8-21-09

DISTRICT 4  
650 MULBERRY  
KANSAS CITY, MO

MISSOURI DEPARTMENT  
OF TRANSPORTATION  
DIVISION OF GENERAL SERVICES  
FACILITIES MANAGEMENT

ADDENDUM 002  
2,000 Gallon Diesel Tank Pad

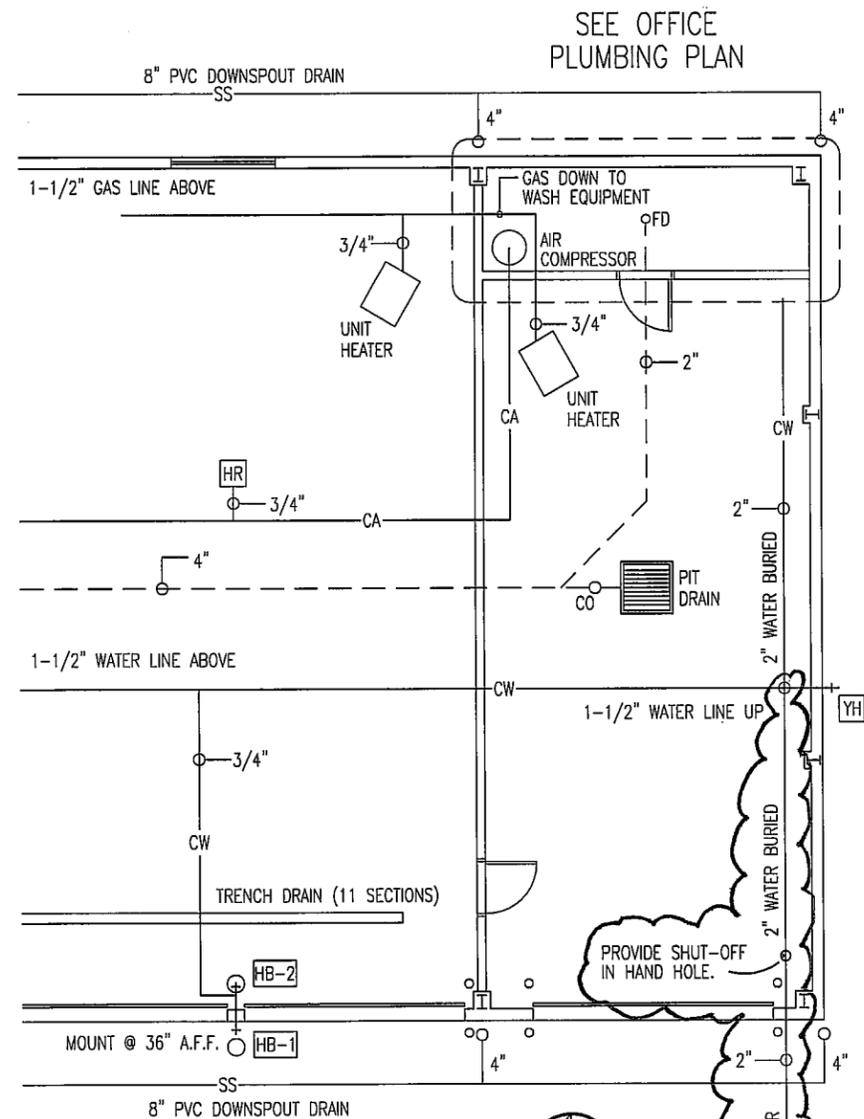


**PARTIAL PLUMBING PLAN**

SCALE: 3/32" = 1'-0"



TO FABRIC SALT STRUCTURE. SEE SITE PLAN.

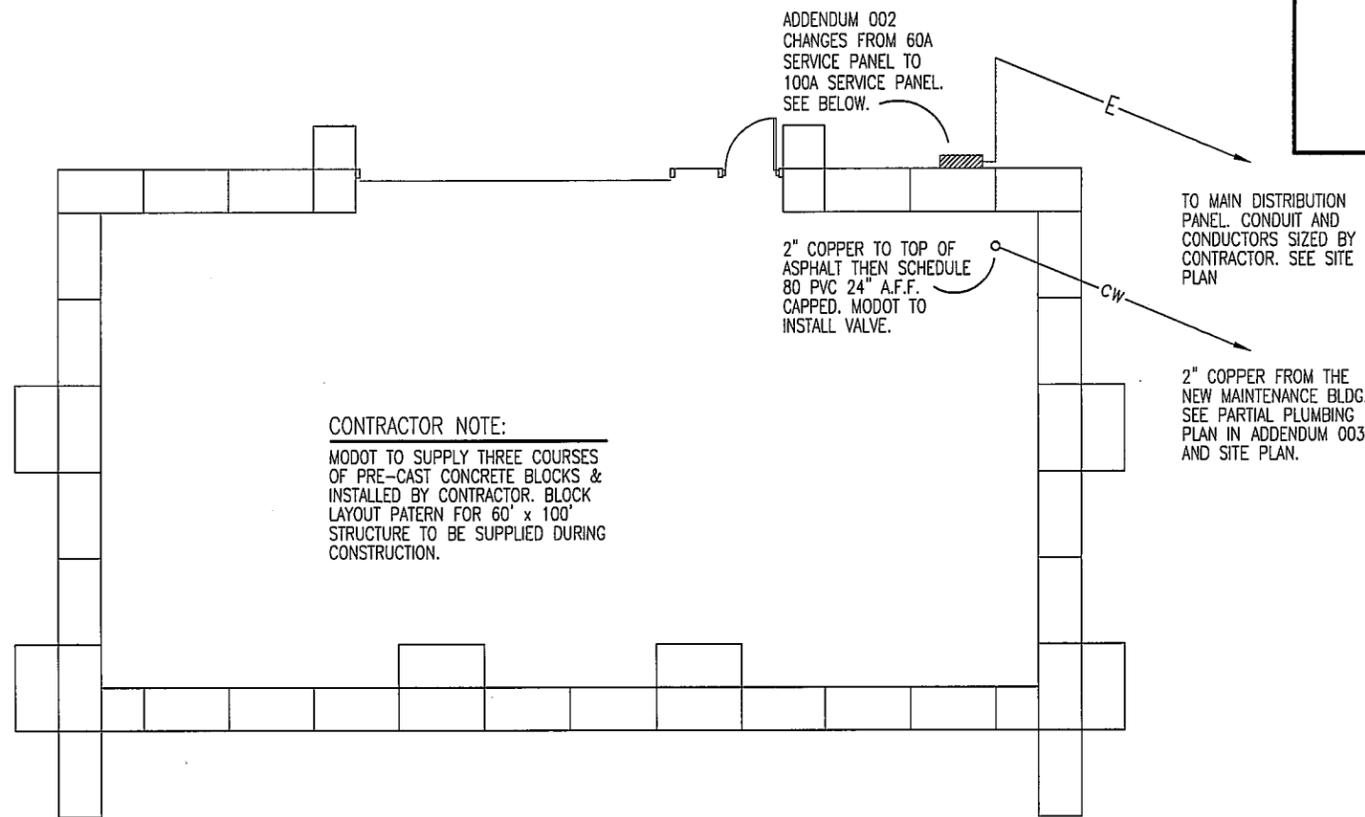

ELECTRICAL & WATER

**PARTIAL FABRIC SALT STRUCTURE**

SCALE: 3/32" = 1'-0"



FABRIC SALT STRUCTURE SERVICE PANEL							
MAIN BUS: 100A MLO		SQUARE "D" NQ-18L1 INTERIOR OR EQUAL		CONNECTED LOAD			
VOLTS: 240/120, 1PH, 3-WIRE		W/NEUTRAL BUS & GROUNDING BUS		A PHASE 2400 VA			
BUS MATERIAL: COPPER		CIRCUIT BREAKERS BOLT-IN 10000 AIC		B PHASE 3072 VA			
MOUNTING: SURFACE		IN MH26WP Exterior Box & NC265 Cover		TOTAL 5472 VA			
				23 A			
CIR	SERVICE	VA	BKR	BKR	VA	SERVICE	CIR
1	LIGHTS	984	30A1P	A	30A1P 984	LIGHTS	2
3	RECEPTACLES/OHD OPENER	1536	20A1P	B	20A1P 1536	RECEPTACLES/OHD OPENER	4
5	EXTERIOR - LIGHTS	432	20A1P	A	20A1P	SPACE ONLY	6
7	SPACE ONLY			B		SPACE ONLY	8
9	SPACE ONLY			A		SPACE ONLY	10
11	SPACE ONLY			B		SPACE ONLY	12
13	SPACE ONLY			B		SPACE ONLY	14
15	SPACE ONLY			B		SPACE ONLY	16
17	SPACE ONLY			B		SPACE ONLY	18


▲ CIRCUIT BREAKER SHALL BE RATED FOR HID LIGHTING

DESIGN BY: LARRY CARVER  
DRWN. BY: LARRY CARVER  
DATE: 8-21-08

DISTRICT 4  
650 MULBERRY  
KANSAS CITY, MO

MISSOURI DEPARTMENT  
OF TRANSPORTATION  
DIVISION OF GENERAL SERVICES  
FACILITIES MANAGEMENT

ADDENDUM 002  
Partial Fabric Structure

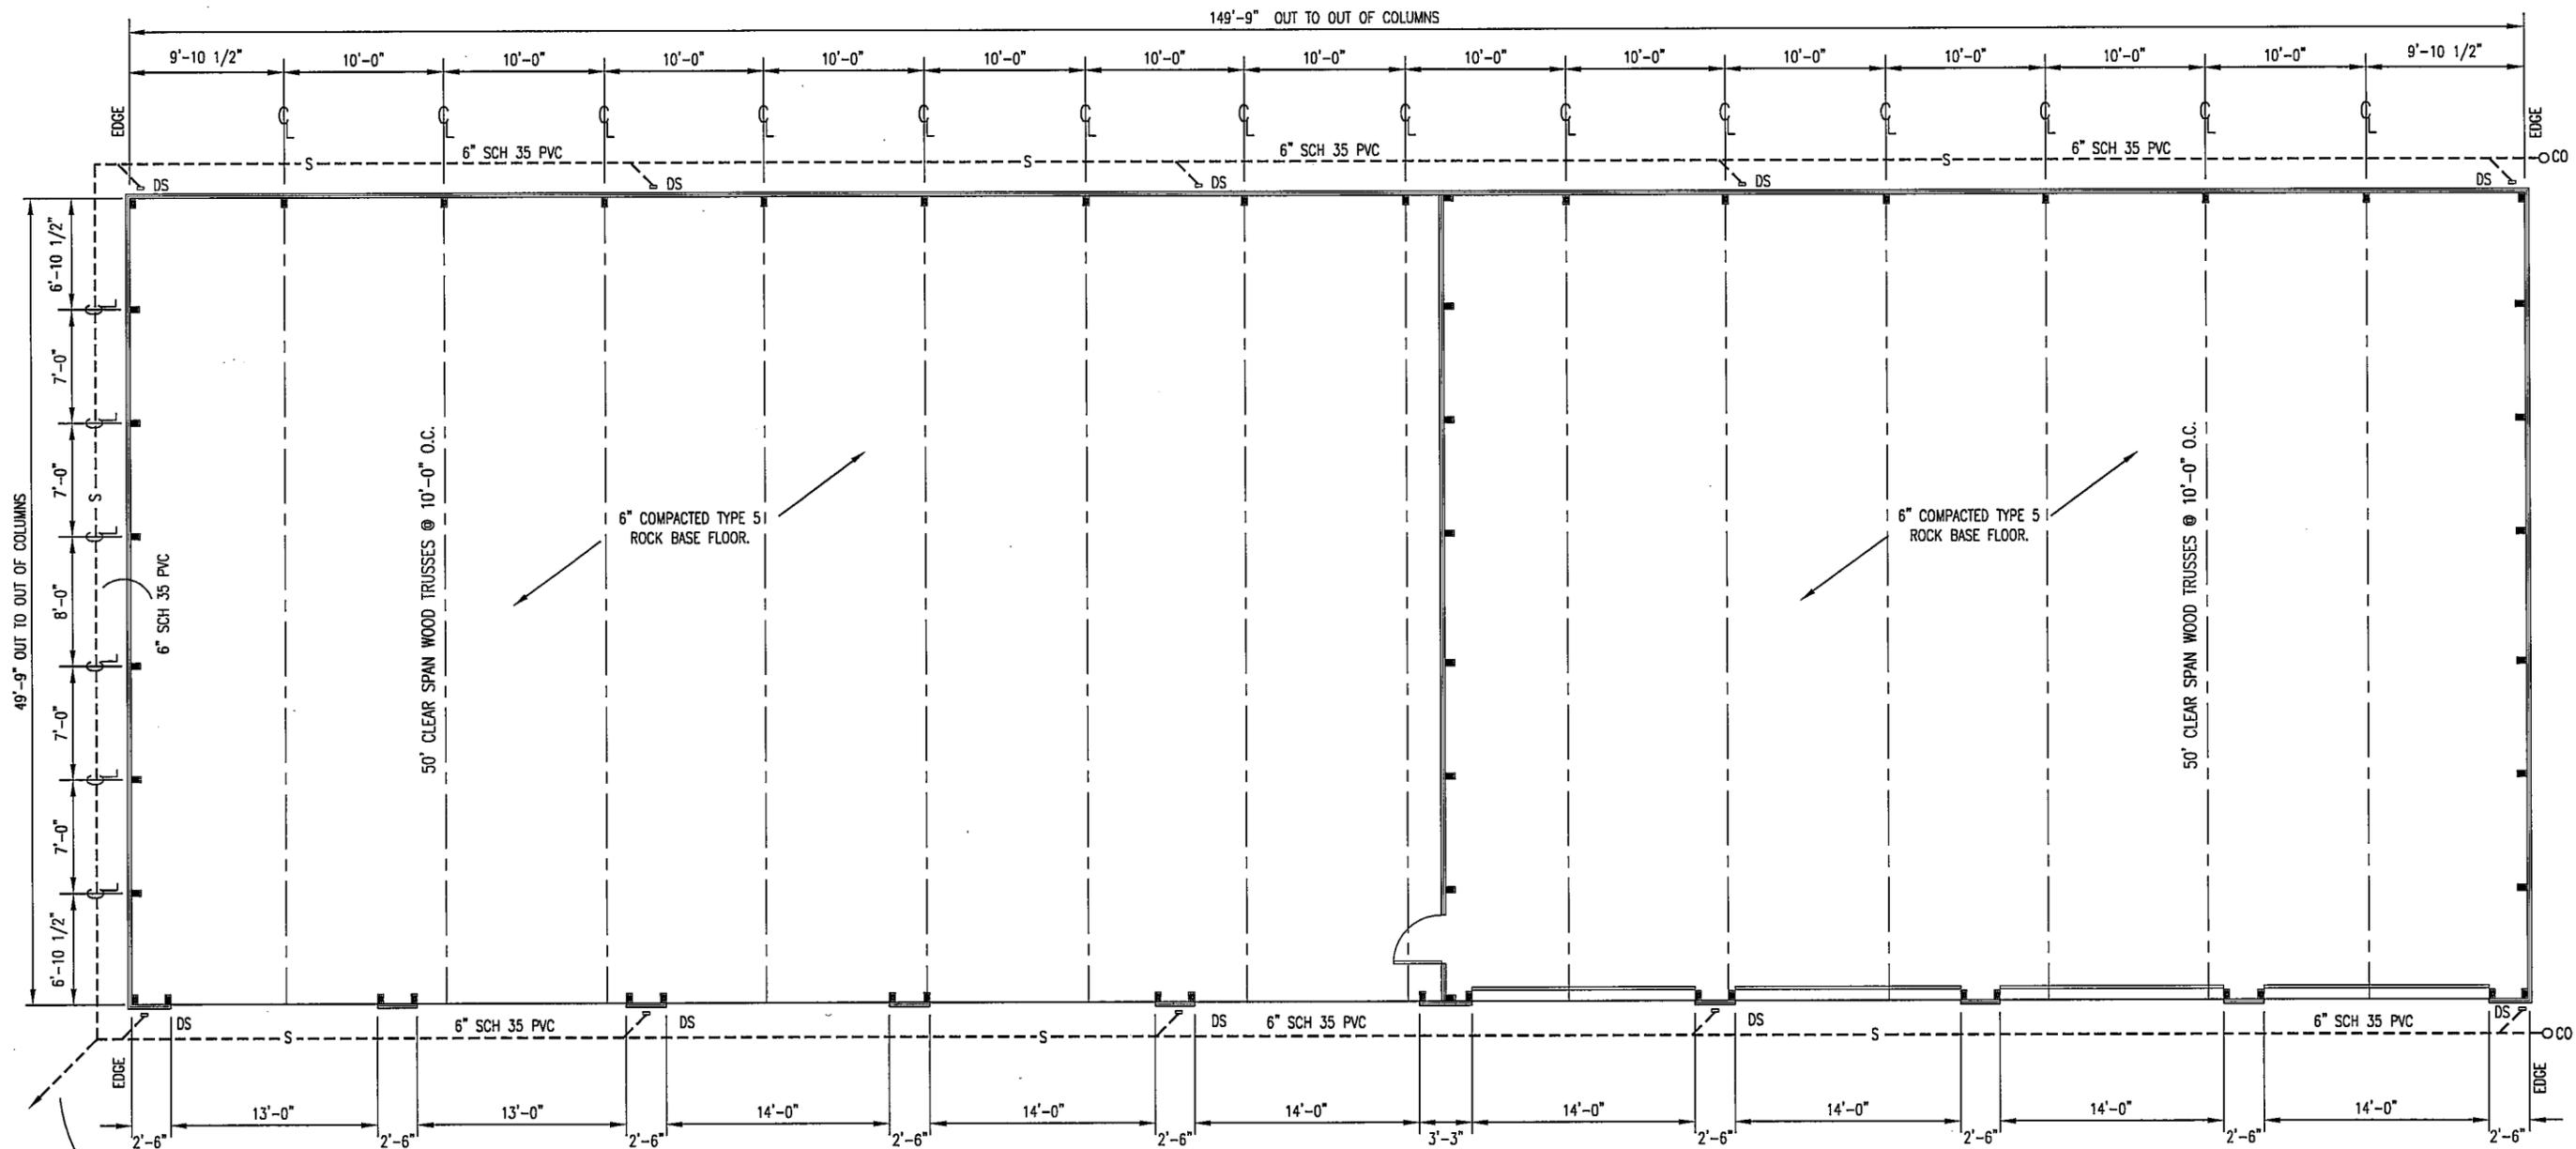

6" SCHEDULE 35 PVC  
TO DROP INLET. SEE  
SITE PLAN.

**CONTRACTOR NOTE:**  
FOR DOWNSPOUT ADAPTERS  
SEE DETAIL D-6 ON THE  
MAINTENANCE BUILDING  
PLANS. (TYPICAL)

**A**  
**3** **DIMENSIONAL FLOOR PLAN**  
SCALE: 3/32" = 1'-0"

ADDENDUM 002

DISTRICT 4 - 650 MULBERRY  
STORAGE BUILDING

MISSOURI DEPARTMENT  
OF TRANSPORTATION  
GENERAL SERVICES  
FACILITIES MANAGEMENT

Dimensional Floor Plan

DESIGN BY: DOUG RECORD  
DRAWN BY: LARRY CARVER  
DATE: 8-24-09  
CHECK BY: JERROLD SCARLETT  
SHEET  
3 of 12