

*Doyle A. Record*  
MISSOURI  
DOUGLAS A. RECORD  
NUMBER  
A-2009032624

11-18-11

DATE: 11-18-11  
DRAWN BY: [illegible]  
CHECKED BY: [illegible]

INDEX OF DRAWINGS

- 1-3 COVER SHEET
- 2-3 PLOT PLAN
- 3-3 PLAN VIEW

MISSOURI DEPARTMENT  
OF TRANSPORTATION

(3) 50' x 70' CONCRETE PADS  
KANSAS CITY DISTRICT  
KC STADIUM COMPLEX  
9101 East 40th Terrace  
Jackson County


CODE REQUIREMENTS

BUILDING CODE - CURRENT IBC

(3) 50' x 70' Concrete Pads  
Kansas City District  
KC STADIUM COMPLEX

MISSOURI DEPARTMENT  
OF TRANSPORTATION  
DIVISION OF GENERAL SERVICES  
FACILITIES MANAGEMENT

COVER SHEET

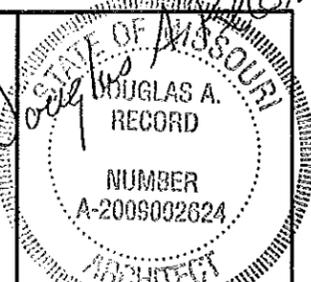

11.18.11








ISSUED BY: RYAN E. BOND  
DRAWN BY: LARRY CARER  
DATE: 11-18-11

(3) 50' x 70' Concrete Pads  
Kansas City District  
KC STADIUM COMPLEX

MISSOURI DEPARTMENT  
OF TRANSPORTATION  
DIVISION OF GENERAL SERVICES  
FACILITIES MANAGEMENT


PLOT PLAN


Sheet 2 of 3

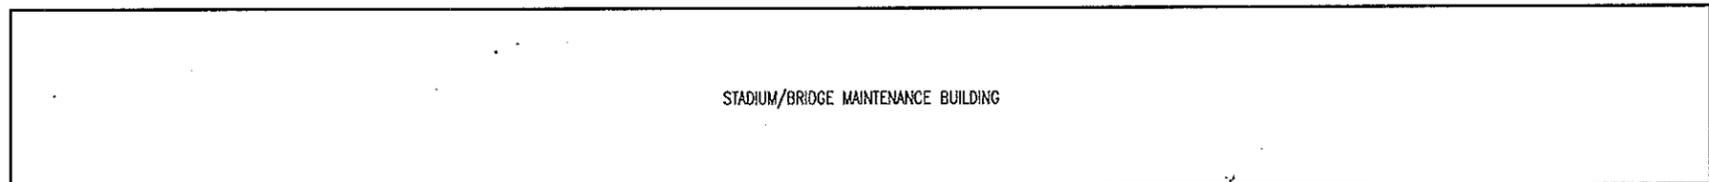




STADIUM/BRIDGE MAINTENANCE BUILDING

A  
2  
PLOT PLAN  
SCALE: 1" = 50'-0"



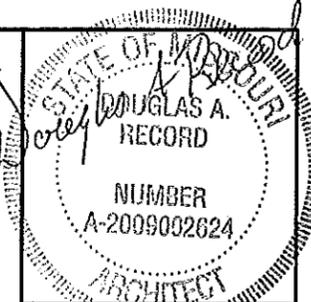

11-18-11

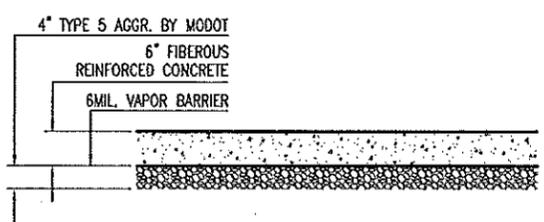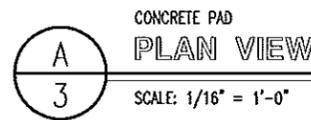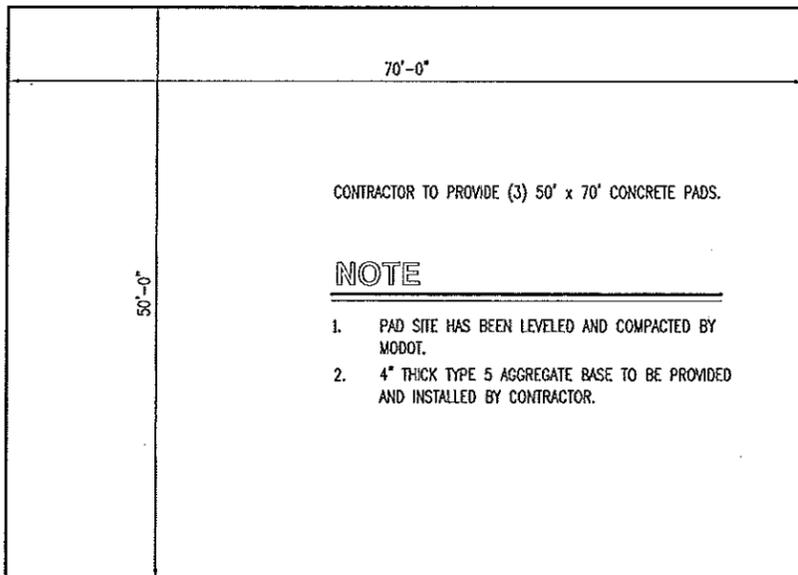

CONCRETE SECTION (TYPICAL)

NTS

CONCRETE AND SITE NOTES

1. CONCRETE WORK SHALL BE EXECUTED IN STRICT COMPLIANCE WITH THE LATEST EDITION OF THE AMERICAN CONCRETE INSTITUTE (A.C.I.) MANUAL OF CONCRETE PRACTICE.
2. CONTRACTOR SHALL ASSUME A SOIL BEARING CAPACITY OF 2000 PSF. IF WET OR UNUSUAL CONDITIONS ARE ENCOUNTERED, NOTIFY THE DESIGNER AND CONSTRUCTION INSPECTOR BEFORE PROCEEDING WITH THE WORK.
3. BUILDING LOCATION HAS BEEN STAKED AND EXCAVATED TO 10" BELOW FINISH GRADE. APPROXIMATE LOCATIONS SHOWN ON PLOT PLAN.
4. ALL CONCRETE SHALL BE TYPE 1 CEMENT WITH A COMPRESSIVE STRENGTH OF 4,000 PSI @ 28 DAYS WITH 4" TO 5" SLUMP.
5. CONCRETE SHALL RECEIVE AIR ENTRAINMENT 6% +/- 2%.
6. CONCRETE FLATWORK SHALL HAVE A LIGHT BROOM FINISH.
7. SAWED CONTROL JOINTS SHALL BE CUT @ 20'-0" O.C. EACH WAY, CLEANED FREE OF ALL DEBRIS AND FILLED WITH PRC PERMAPOL "RC-550" JOINT SEALANT OR APPROVED EQUAL.
8. CONCRETE SLAB SHALL RECEIVE A CURING/SEALING FINISH PER SPECIFICATION SECTION 03370.
9. SEE SPECIFICATION SECTION 03300 CONCRETE FOR ADDITIONAL INFORMATION.

MISSOURI DEPARTMENT  
 OF TRANSPORTATION  
 DIVISION OF GENERAL SERVICES  
 FACILITIES MANAGEMENT

(3) 50' x 70' Concrete Pads  
 Kansas City District  
 KC STADIUM COMPLEX